

A2 LSOH

COMPRESSION GLAND

for Unarmoured Fire Rated Cable



Features and Benefits

- For indoor and outdoor use.
- Seals the cable sheath to IP65/66/68.
- Silicon seals are fire retardant, low smoke zero halogen and are suitable for extreme temperatures.
- Precision manufactured from high quality brass (nickel plated) available in aluminium or stainless steel 316/316L on request.
- Complete with heavy duty locknut.
- Complete with fire retardant, low smoke zero halogen, extreme temperature thread sealing gasket.




Technical Data

Type:	A2 LSOH
Gland Material:	Brass (Nickel Plated) BS 2874, EN 12164, Aluminium ASTM BS221 or Stainless Steel 316/316L
Seal Material:	LSOH Silicon
Cable Type:	Unarmoured Fire Rated
Sealing Area:	Outer Sheath
Optional Accessories:	Adaptor, Reducer, Earth Tag, Locknut, Serrated Washer and Shroud

Standards and Certifications

Mechanical Properties:	Impact Category 8	
	Anchorage Type B	
Operating Temperature:	-65°C to +175°C (continuous)	
Conformance:	Standard:	Certificate:
Design Standards	BS 6121:Part 1	CML 14CA364
	EN 50262	CML 14CA364
	IEC/BS EN 62444	CML 14CA364
	SANS 62444	MASC 11-303
	SANS 1213	2109/4596, S787/D586
IP66/68 100m - Parallel	IEC 60529	CML 15Y728, MASC 11-263
IP65 - Tapered	IEC 60529	
Marine ABS	IEC 62444	ABS 14-SG1246753-2-PDA
DNV-GL	IEC 60529, BS 6121, IEC 62444	DNV-GL TAE000000Z
Halogen Free	IEC 60754-2	TDWR 14-04-13
Flame Retardant	ASTM D 2863-09, ISO 4589-2	TDWR 14-04-13
Low Smoke	EN45545-2	CSIR 24580f
London Underground Approval	BS EN 62444	LU 3043

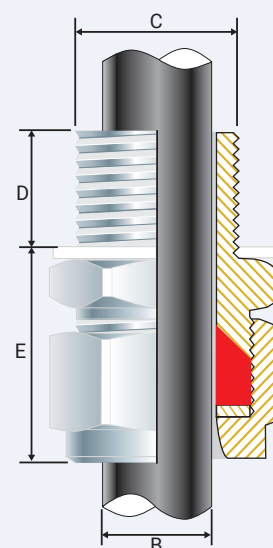

Installation Standards

- AS/NZS 3000
- BS 6121-5
- BS 7671
- BS 7430
- IEC 60364-5-54
- SANS 0142


Product Code	Gland Size Reference	Metric Entry Thread		NPT Entry Thread		Cable Detail		Maximum Length 'E'	Hexagonal Detail		Installation Torque Value Nm
		'C'	Min 'D'	'C'	Min 'D'	Min 'B'	Max 'B'		Max 'Flats'	Max 'Crns'	
055200-16S	00-16S	M16x1.5	10	-	-	1.0	6.0	20.0	18.0	20.0	20.0
055200-16	00-16ss	M16x1.5	10	-	-	3.0	8.5	20.0	24.0	27.0	32.5
055200	00-20ss	M20x1.5	10	1/2/3/4	15	3.0	8.5	20.0	24.0	27.0	32.5
0552-0	0-20s	M20x1.5	10	1/2/3/4	15	7.0	11.5	20.0	24.0	27.0	32.5
055201	1-20	M20x1.5	10	1/2/3/4	15	11.0	15.0	24.0	27.0	30.0	32.5
055222	2s-25s	M25x1.5	10	3/4/1	15/19	11.5	17.5	25.0	35.0	39.0	47.5
055202	2-25	M25x1.5	10	3/4/1	15/19	15.0	20.0	25.0	35.0	39.0	47.5
055233	3s-32s	M32x1.5	10	1/1 1/4	19	16.0	22.0	30.0	42.0	47.0	55.0
055203	3-32	M32x1.5	10	1/1 1/4	19	20.0	26.5	30.0	42.0	47.0	55.0
055244	4s-40s	M40x1.5	15	1 1/4/1 1/2	19/21	22.0	31.5	30.0	52.0	59.0	65.0
055204	4-40	M40x1.5	15	1 1/4/1 1/2	19/21	26.0	34.0	30.0	52.0	59.0	65.0
055255	5s-50s	M50x1.5	15	1 1/2	21	29.0	38.0	42.0	65.0	73.0	82.5
055205	5-50	M50x1.5	15	2	21	34.0	44.5	42.0	65.0	73.0	82.5
055266	6s-63s	M63x1.5	15	2	21	38.0	50.0	48.0	80.0	90.0	97.5
055206	6-63	M63x1.5	15	2 1/2	30	44.5	56.5	48.0	80.0	90.0	97.5
055277	7s-75s	M75x1.5	15	2 1/2	30	50.0	62.0	50.0	96.0	108.0	115.0
055207	7-75	M75x1.5	15	3	32	56.0	67.5	50.0	96.0	108.0	115.0
055288	8s-80s	M80x2.0	20	3	32	54.0	69.0	55.0	96.0	108.0	120.0
055208	8-80	M80x2.0	20	3	32	65.0	74.0	55.0	96.0	108.0	120.0
055299	9s-90s	M90x2.0	20	3	32	60.0	75.0	60.0	111.0	125.0	120.0
055209	9-90	M90x2.0	20	3 1/2	33	73.0	81.5	60.0	111.0	125.0	120.0
055210	10-100	M100x2.0	20	3 1/2/4	33/34	81.0	91.0	74.0	-	-	120.0
055211	11-110	M110x2.0	20	4	34	91.0	101.0	92.5	-	-	175.0
055212	12-120	M120x2.0	20	-	-	101.0	109.0	92.5	-	-	175.0
055213	13-130	M130x2.0	20	-	-	109.0	119.0	92.5	-	-	175.0

All dimensions except NPT are in mm.

CCG reserves the right to make alterations to the technical data, dimensions, designs and products available without notice. The illustrations cannot be considered binding. Please contact CCG for assistance.


A2LSOH-LS010518E

A2 LSOH COMPRESSION GLAND

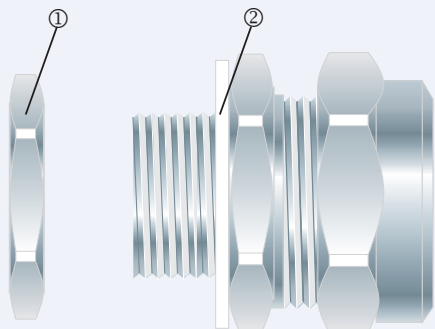


1. To maintain IP66/68 ensure the gasket ② is in place. Remove locknut ①.


Alternative installation through an unthreaded entry.

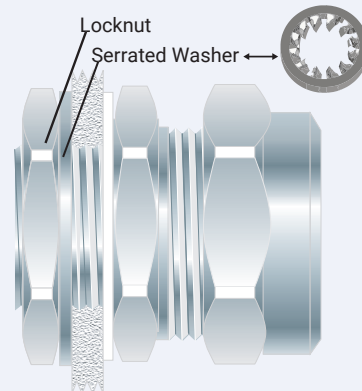


If the apparatus is untapped use a locknut.

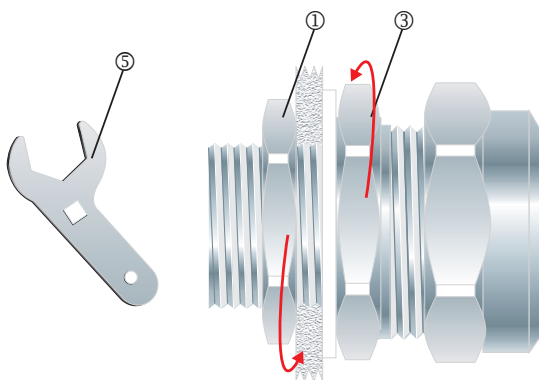

2. Screw the inner ③ into the apparatus and tighten the inner ③ to the installation torque using a CCG Spanner ⑤. Tighten the locknut ①.

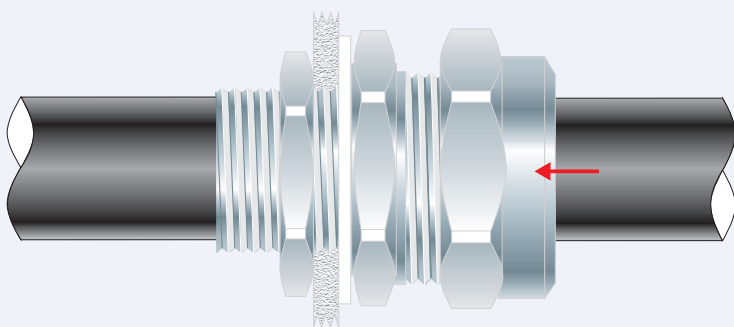

3. Pass the cable end through the gland assembly.

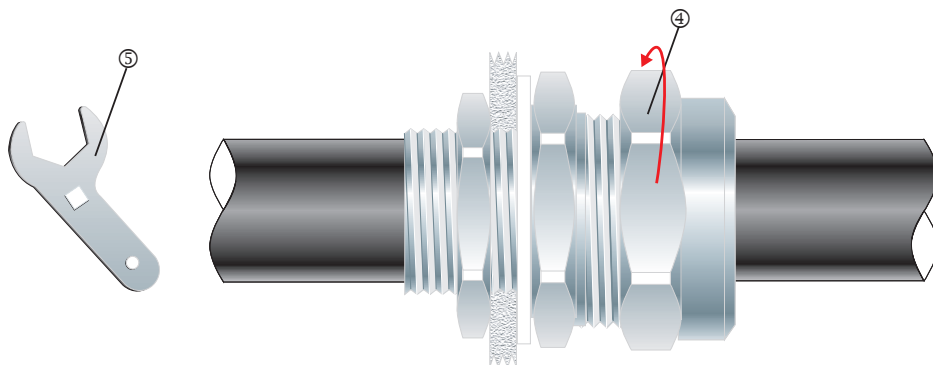

4. Tighten the outer ④ to the installation torque using a CCG Spanner ⑤.